

The 37-001 Process Control Workshop is a Process Trainer with control interface and simulation for use with **MATLAB**<sup>®</sup> software.

- Representative of a transport-delay control problem.
- Real-Time control system with embedded algorithms via **MATLAB**<sup>®</sup>/**SIMULINK**<sup>®</sup>.
- Integrated software supports identification, modeling, design and simulation, real-time implementation.
- Ideal for teaching the basic principles of Process Control to technicians and engineers.
- Suitable for both laboratory and projects work.

The Process Control Workshop contains:

- **37-100 Process Control Trainer**
- **37-102 Interface Unit**
- **37-902 Software Pack - includes Advantech I/O card and connecting cables.**

## Description

The Process Control Workshop is used to introduce process control techniques and with the additional software and **MATLAB®/SIMULINK®** software will provide an insight into advanced control principles.

The Process is represented by a heating element controlled by a thyristor circuit that feeds heat into the airstream circulated by an axial fan along a polypropylene tube.

A thermistor detector can be placed at one of three points along the tube, sensing the temperature at that point.

The volume of air flow is controlled by varying the speed of the fan via a potentiometer ('throttle control') in the range 10% to 100%.

### Curriculum covered

- Distance/Velocity Lag
- Transfer Lag
- Calibration
- Two-step control
- Proportional control
- Disturbance & system response
- Frequency response
- Compound controller action


### Using MATLAB®/SIMULINK® and associated Toolboxes

- Real-time Digital Control
- Transfer Function and State-space representation
- Single input/Single output feedback control in time domain
- PID Control
- Mathematical Modelling
- Linear Quadratic (LQ) Control

## Applications

**Closed loop digital control** The system (hardware & software) is divided into four categories:

- **Computer**
- **Controller**
- **Process**
- **Measurement**

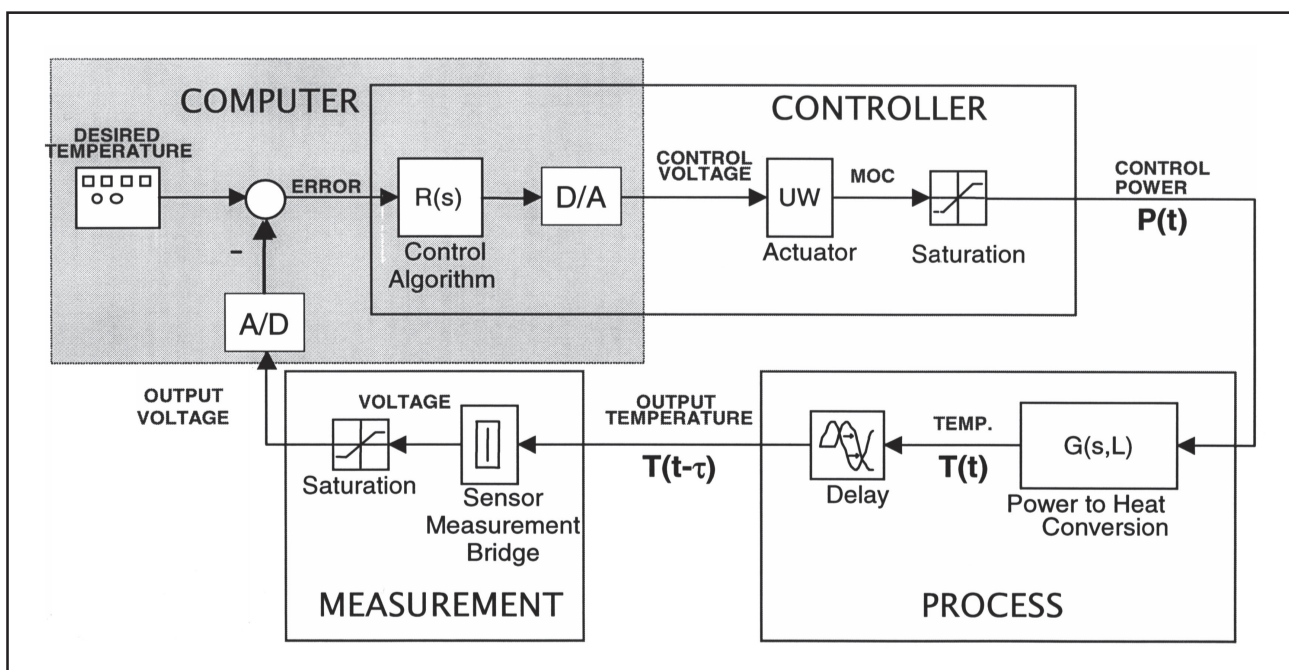

## Computer

The output voltage signal corresponding to the measured temperature is converted by 12-bit ADC and applied to the computer. The desired (reference) temperature is generated by a software **excitation source**. The error is applied to the **control algorithm**, which then calculates a digital control signal. A DAC using zero-order-hold principles converts the control output into an analogue signal.

## Controller

The variable power supply (**actuator**) provides an electrical output as determined by the controller signal. Since the power applied to the heater is limited (0 to 80W), another saturation block is necessary to represent the behaviour of the system correctly.


### PID Control

An extension to the practical and experimental work is the design, simulation and implementation of real-time PID (3-term) controller. As simple demonstrations, these show the powerful action of a 3-term controller in reducing deviation and improving response time.

### Optimal design method: LQ Control

The principles of Linear Quadratic control and State Space representation of the process are introduced. The software contains not only the implementation in real-time of LQ Control for the Process Trainer Unit,

but the simulation of complete closed loop control.

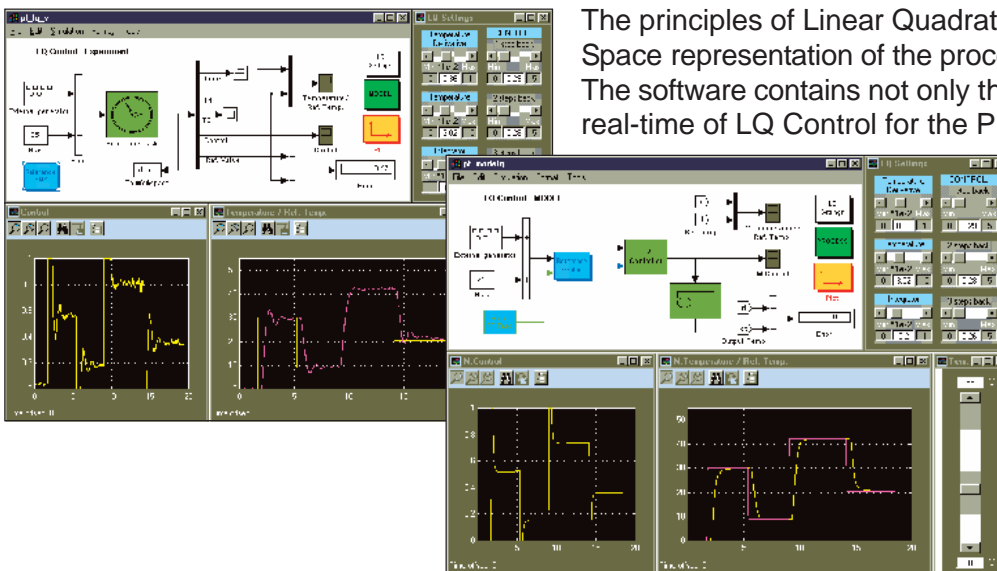

## Process

The power  $P(t)$ , applied to the heater is the process input, the temperature measured in the location of the sensor  $T(t - t)$  is the output of the process.

**Electrical power to heat conversion** - represented by a transfer function of the second order, a series combination of heater model and the model of heat transfer between heater and air.

**Delay** - time taken by the temperature signal between the input (heater:  $T(t)$ ) and the output (sensor location:  $T(t - t)$ ).

## Measurement

**Sensor** - positioned into the air stream at one of the three points along the tube.

Measurement bridge circuit and amplifier - converting the resistance variations into voltage signal variations in the range (0, 10) volts.

**Saturation of the measurement channel** - non linearity provided by the limitations of the measurement signal (range: 0 to 60°C).

## Specification

<b>Maximum heater power</b>	80W
<b>Velocity flow range</b>	1 - 10ft/sec (0.304 - 3.05m/sec)
<b>Detector temperature range</b>	Ambient to 80°C
<b>Heater/detector time constant</b>	400ms
<b>Typical distance - velocity lag</b>	200ms
<b>Typical natural period</b>	1.0 second
<b>Tube length</b>	298mm (11.75in)
<b>Electrical input and output range</b>	±10V
<b>Manuals supplied</b>	Installation and Commissioning, Getting Started, Reference Manual and Advanced Teaching Manual
<b>Power requirements</b>	220 - 250V or 100 - 120V. 50 or 60Hz, 170VA
<b>Dimensions and Weight</b>	Width: 520mm, Depth: 292mm, Height: 216mm, Weight: 5.6kg
<b>Ordering Information</b>	Process Control Workshop ( includes 37-100, 37-102 & 37-902) 37-001 <b>Items available separately:</b> Process Control Trainer 37-100 Interface Unit 37-102 Process Control Workshop upgrade (includes 37-102 & 37-902) 37-110 Software pack (includes Advantech card and connecting cables) 37-902
<b>Process Control Workshop Upgrade Pack 37-110</b>	This is available to customers who already own Process Trainer 37-100 or PT326. It is designed to extend the original assignments so that they can be used with toolbox software within <b>MATLAB</b> <sup>®</sup> . The pack contains 37-102 and 37-902.
<b>Additional Equipment</b>	A PC running Microsoft Windows <sup>®</sup> 2000 or XP with Pentium III or IV processor. 400Mbytes of disk space with 512Mbytes of RAM recommended; VGA graphics; a mouse; CD ROM or DVD drive; Microsoft internet explorer 4.0 or above; Adobe Acrobat reader 3.0 or above. TCP/IP is required on all platforms when using a license server. <b>MATLAB</b> <sup>®</sup> and <b>SIMULINK</b> <sup>®</sup> with Signal Processing Toolbox and Control System Toolbox, Real-time Workshop and Real-time Windows Target; Microsoft <sup>®</sup> Visual C.net.

**MATLAB**<sup>®</sup>, **SIMULINK**<sup>®</sup> and their toolboxes are registered products of The Mathworks Inc. and are not included with the system. Microsoft Windows<sup>®</sup> and Microsoft .net<sup>®</sup> are registered Trade Marks of the Microsoft Corporation.

 **Feedback**  
Feedback Instruments Limited  
Park Rd, Crowborough, East Sussex,  
TN6 2QR, England.  
Tel: +44 (0) 1892 653322  
Fax: +44 (0) 1892 663719  
E-mail: [feedback@fdbk.co.uk](mailto:feedback@fdbk.co.uk)  
Website: [www.fbk.com](http://www.fbk.com)

For further information on Feedback equipment please contact: . . . . .